

AND TELECOM DRAWINGS FOR ADDITIONAL SYSTEMS AND EQUIPMENT INFORMATION. 2. REFER TO ELECTRICAL DRAWINGS FOR FIRE ALARM

UNIVERSITY OF CALIFORNIA, RIVERSIDE

900 UNIVERSITY AVENUE, RIVERSIDE, CA 92521

SCHOOL OF MEDICINE

**EDUCATION BUILDING II** 

UCR PROJECT NO.: 954045 / CAAN NO.: P5836

**DESIGN PACKAGE 4** 

INTERIOR ARCHITECTURE & SITE

**CO** ARCHITECTS

**HENSEL PHELPS** 

FIRE & LIFE SAFETY ENGINEER

WEBB ASSOCIATES

WODEN FIRE

CIVIL ENGINEER

**HENSEL PHELPS** 

REV DATE

PROFESSIONAL STAMP

**DESIGN-BUILD TEAM** 

CO ARCHITECTS

THORNTON TOMASETTI

MECHANICAL & ELECTRICAL ENGINEER

STRUCTURAL ENGINEER

LANDSCAPE ARCHITECT

C-26166

100% FOR CONSTRUCTION

AGENCY STAMP

SPURLOCK

P2S INC.

6" AFF TO 8'-6" AFF. PAINT BACKBOARD WHITE WITHOUT COVERING FIRE RATING SYMBOL FOR INSPECTION. 12. PARTITION LAYOUT GUIDELINE:

A. DIMENSIONS ARE REFERENCED FROM BUILDING STRUCTURAL GRID, UNLESS NOTED

B. DIMENSIONS ARE TO FACE OF FINISH GYPSUM BOARD TYPICAL, UNLESS OTHERWISE NOTED. C. "MIN CLR" INDICATES CODE REQUIRED CLEAR

D. " G " INDICATES CENTERLINE OF OPENING OR

### FLOOR PLAN LEGEND

ROOM ROOM NAME 1.206 ROOM NUMBER 150 SF → ROOM AREA (SQ FT) **DOOR TAG:** 

> DOOR CLEARANCE OUTLINE; SEE 30/A10.00 FOR DIMENSIONS DOOR NUMBER ——— DOOR TYPE DOOR WIDTH 45 17B HARDWARE GROUP — FIRE RATING(MINUTES)

# **INTERIOR GLAZED OPENING TAG:**

SEE SHEETS A9.32 FOR GLAZED OPENING TYPES

## **PARTITION TAG:**

— PARTITION TYPE - SEE SHEET A9.11 TYPICAL PARTITION IS TYPE 'T' UON

08 41 13.13 INTERIOR ALUMINUM-FRAMED ENTRANCES AND STOREFRONT NON-FIRE-RATED PARTITION WALL

2-HOUR FIRE RATED BARRIER CONCRETE UNIT MASONRY

CONCRETE (CAST IN PLACE)

— 10 44 00 FIRE EXTINGUISHER IN CABINET, SEE DETAIL 1K/A9.01 10 44 00 FIRE EXTINGUISHER ON BRACKET, SEE DETAIL 1K/A9.01

SCHEDULED ART WALL BY OTHERS. COORDINATE FINAL LOCATION/ENTENT WITH CLIENT. PROVIDE LEVEL 5 DRYWALL FINISH. REFER TO PARTIAL PLANS A2.2 SERIES, AND INTERIOR ELEVATIONS.

REGULATORY SIGNAGE, SEE A9.61

FLOOR DRAIN

FLOOR BOX CARD READER

POST MOUNTED CARD READER; SEE 6/A8.25

FIRE EXTINGUISHER CABINET

HOSE VALVE PROPOSED EQ09 TRASH BIN LOCATION IN

OPEN AREAS. FOR SPEC. REFER TO EQUIPMENT SCHEDULE SHEET A2.6. FOR (EQ09) LOCATIONS OTHER THAN OPEN AREAS, REFER TO A5.2 SERIES.

SYMBOL DENOTES 60" DIAMETER MANEUVERING CLEARANCE

# ACCESSIBLE LOCKER

Repeated comment: Identify locations of AEDs, emergency phones, etc. Typical all floors. DB team to propose locations and UCR will review and approve with stakeholders. UCR

On which plan is 2 way communication devices (identified to be on elevator lobbies) indicated?

> Please include corner guards. They were taken out of the package- and are required by Campus

Std. UCR

KEYPLAN NORTH

PARTIAL FLOOR PLAN - LEVEL 1 EAST

SHEET TITLE A2.21A

SHEET NUMBER


epeat comment: Identify h the plan and mark

legend where chair rails re. If located elsewhere

let us know the sheet

thair rails are required per the BOD for the rotection of the walls in

all specified rooms. UCR.

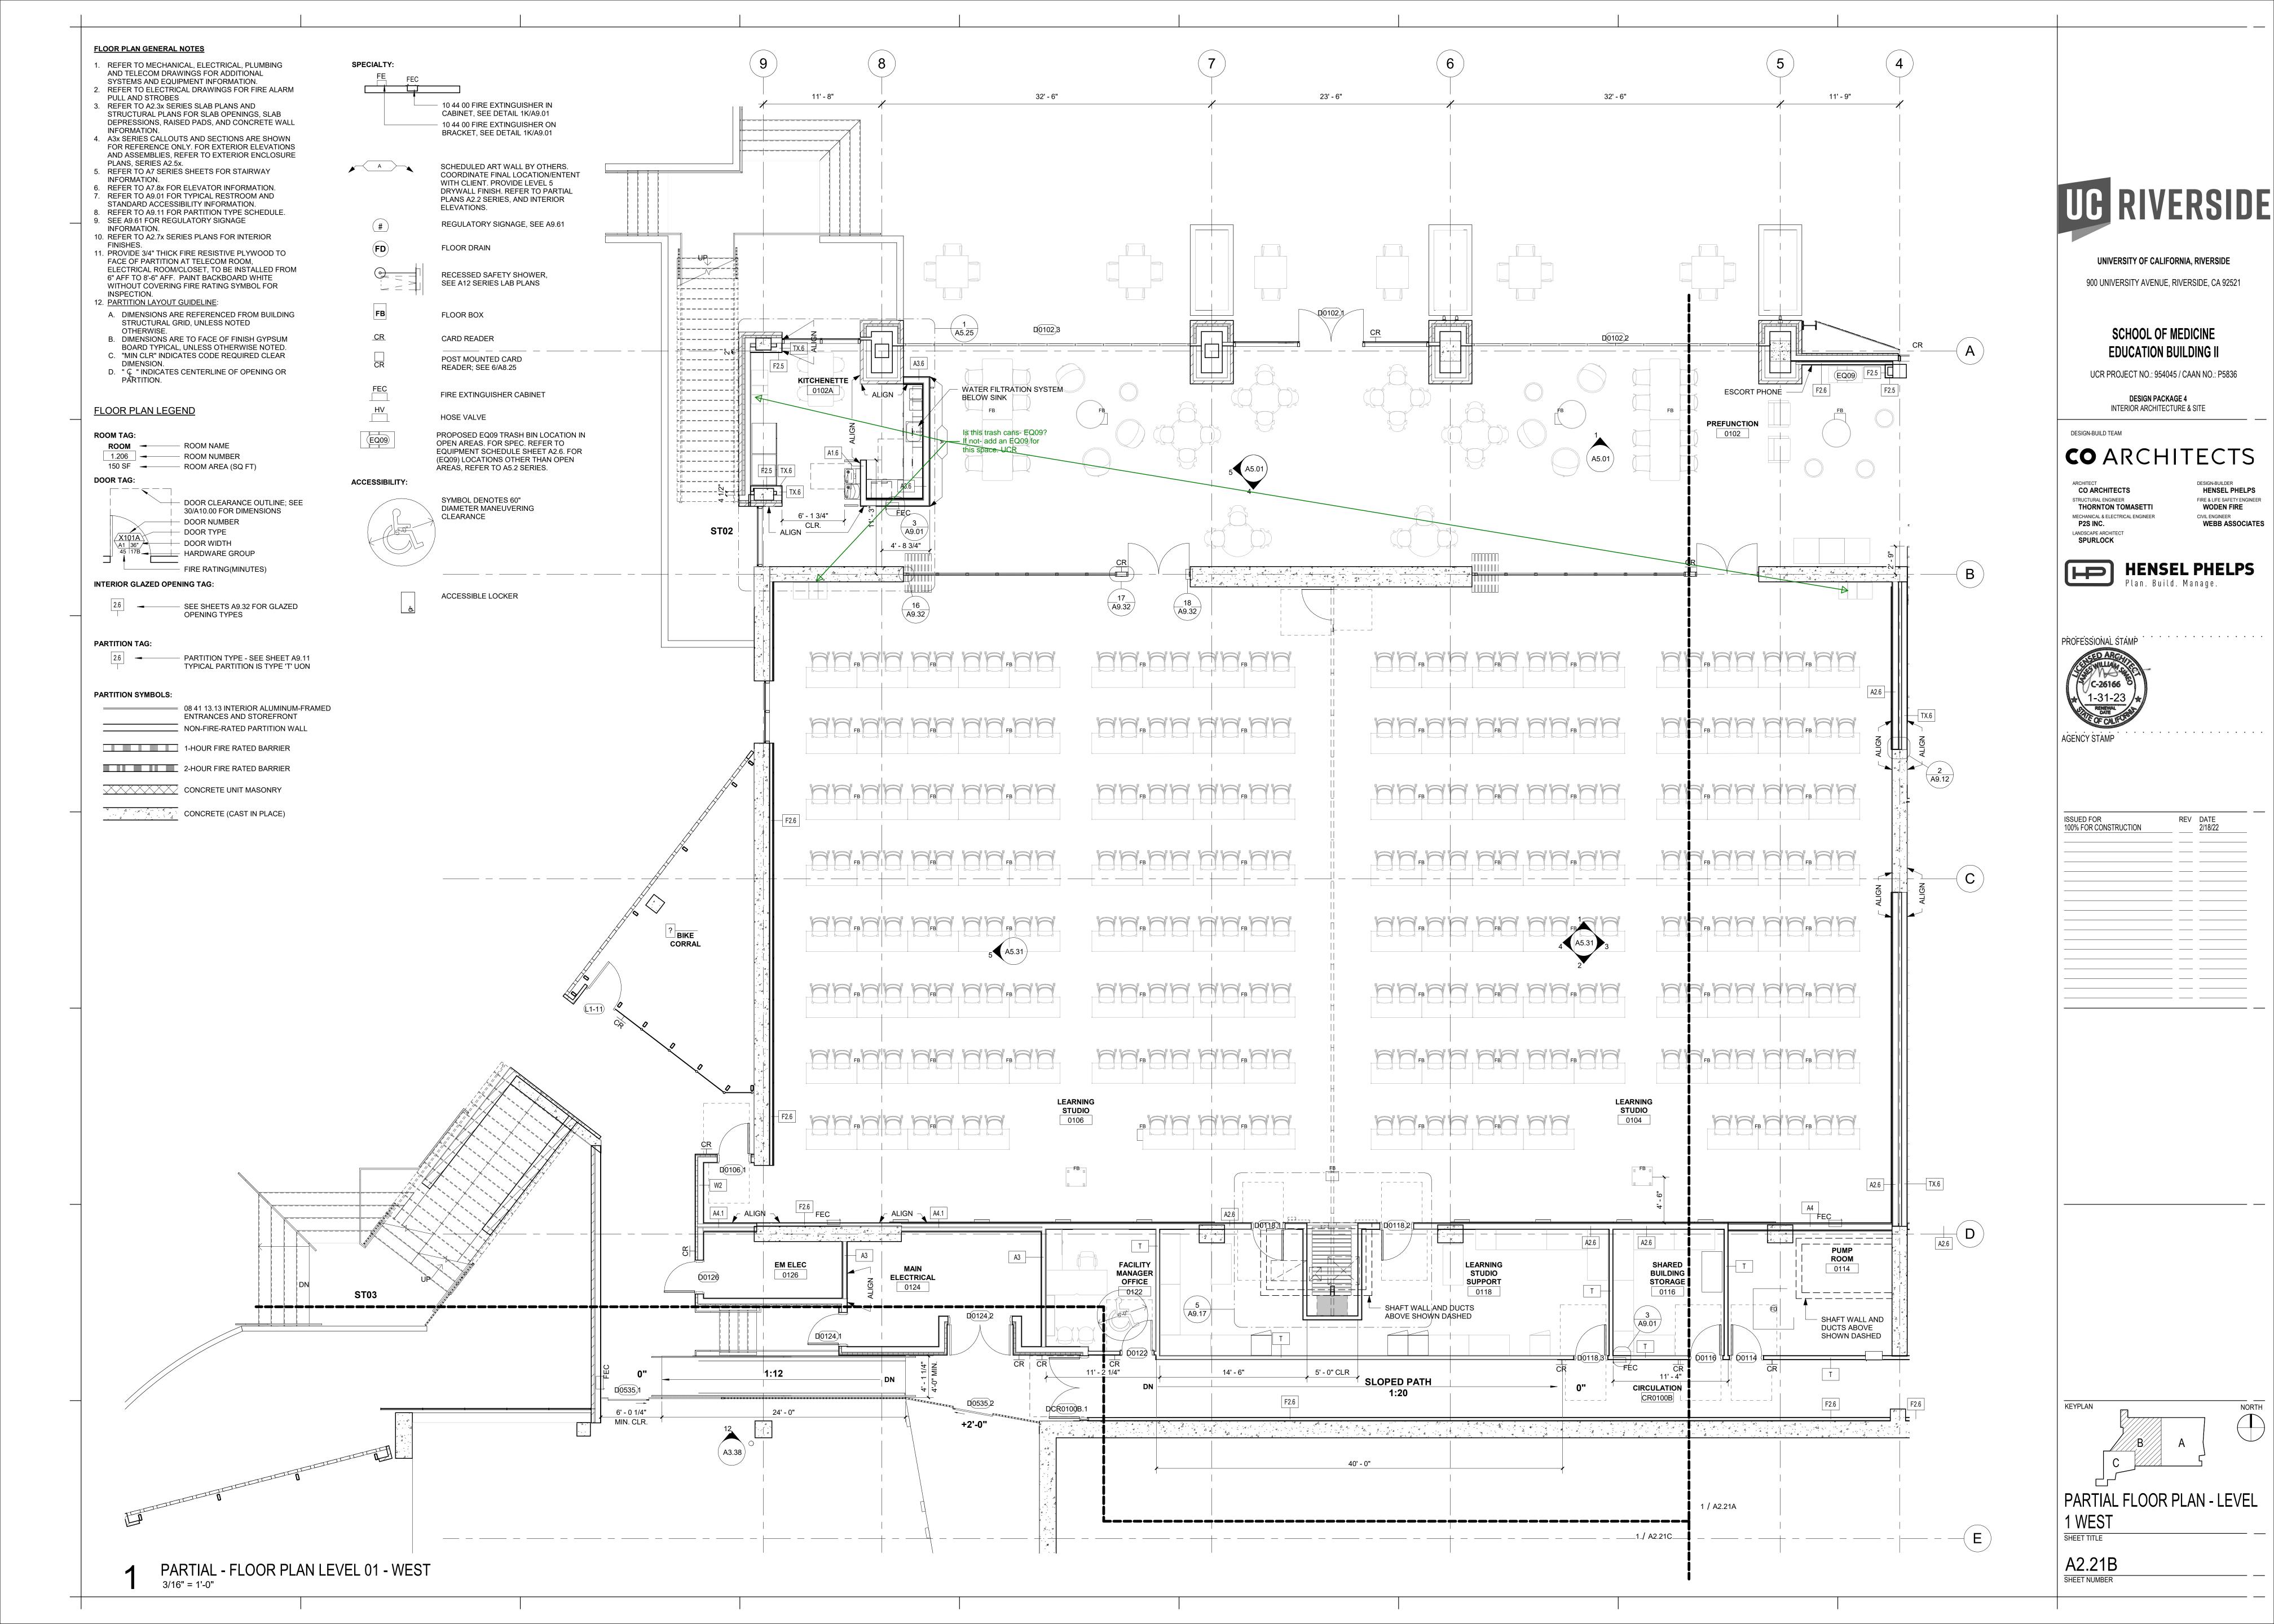

**HENSEL PHELPS** 

FIRE & LIFE SAFETY ENGINEER

WEBB ASSOCIATES

WODEN FIRE

CIVIL ENGINEER